
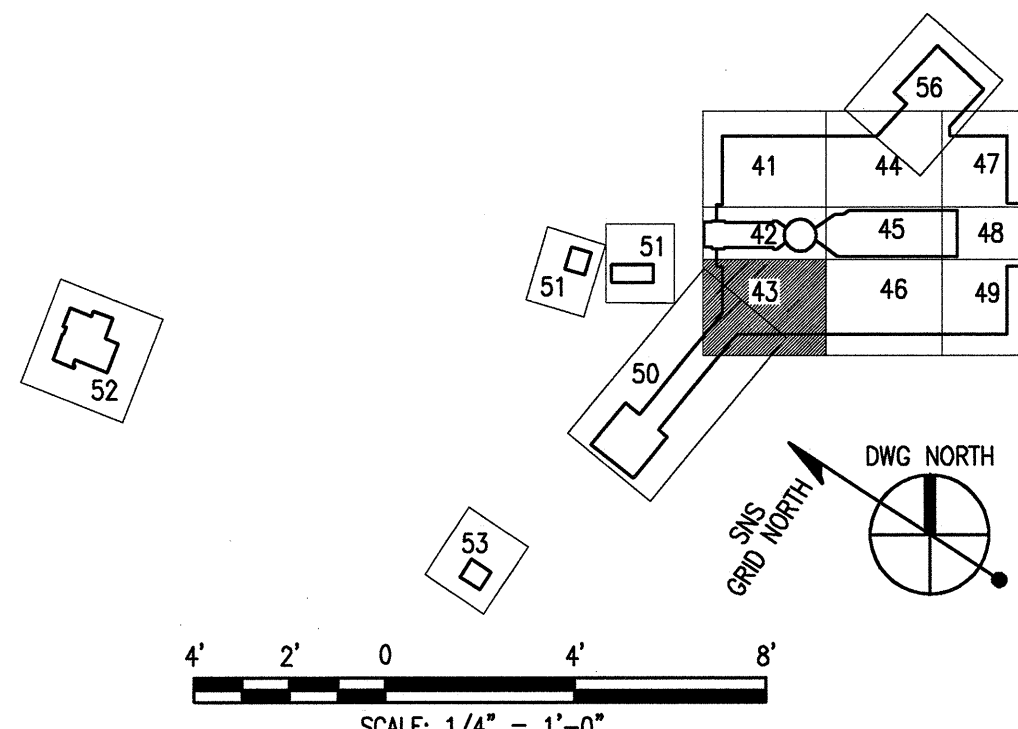


GENERAL NOTES


1. COORDINATE EXACT LOCATION OF EACH LIGHTING FIXTURE WITH CABLE TRAY LAYOUTS AND AIR DUCT LAYOUTS.
2. FIXTURES SHALL BE LOCATED AT THE SAME ELEVATION IN EACH ROOM, UON.
3. FOR LIGHTING PANEL SCHEDULES SEE DWG E9.21.34
4. FOR LIGHTING FIXTURE SCHEDULES SEE DWG E9.30.01
5. PROVIDE 2" RIGID GALVANIZED STEEL SLEEVES FOR ALL CONCRETE CEILING AND WALL CONDUIT PENETRATIONS.
6. HYDROGEN UTILITY ROOM (TA-411) IS CLASS 0, DIV 1 AREA. ALL ELECTRICAL DEVICES IN THE ROOM SHALL BE EX-PROOFED & LISTED FOR USE IN HAZARDOUS AREA.

SHEET KEYNOTES

N001 SEE DWGS. E8.10.32 & E8.10.33 FOR STAIRS NO.1, 2, 5, 6, 7 & 8 SECTIONS

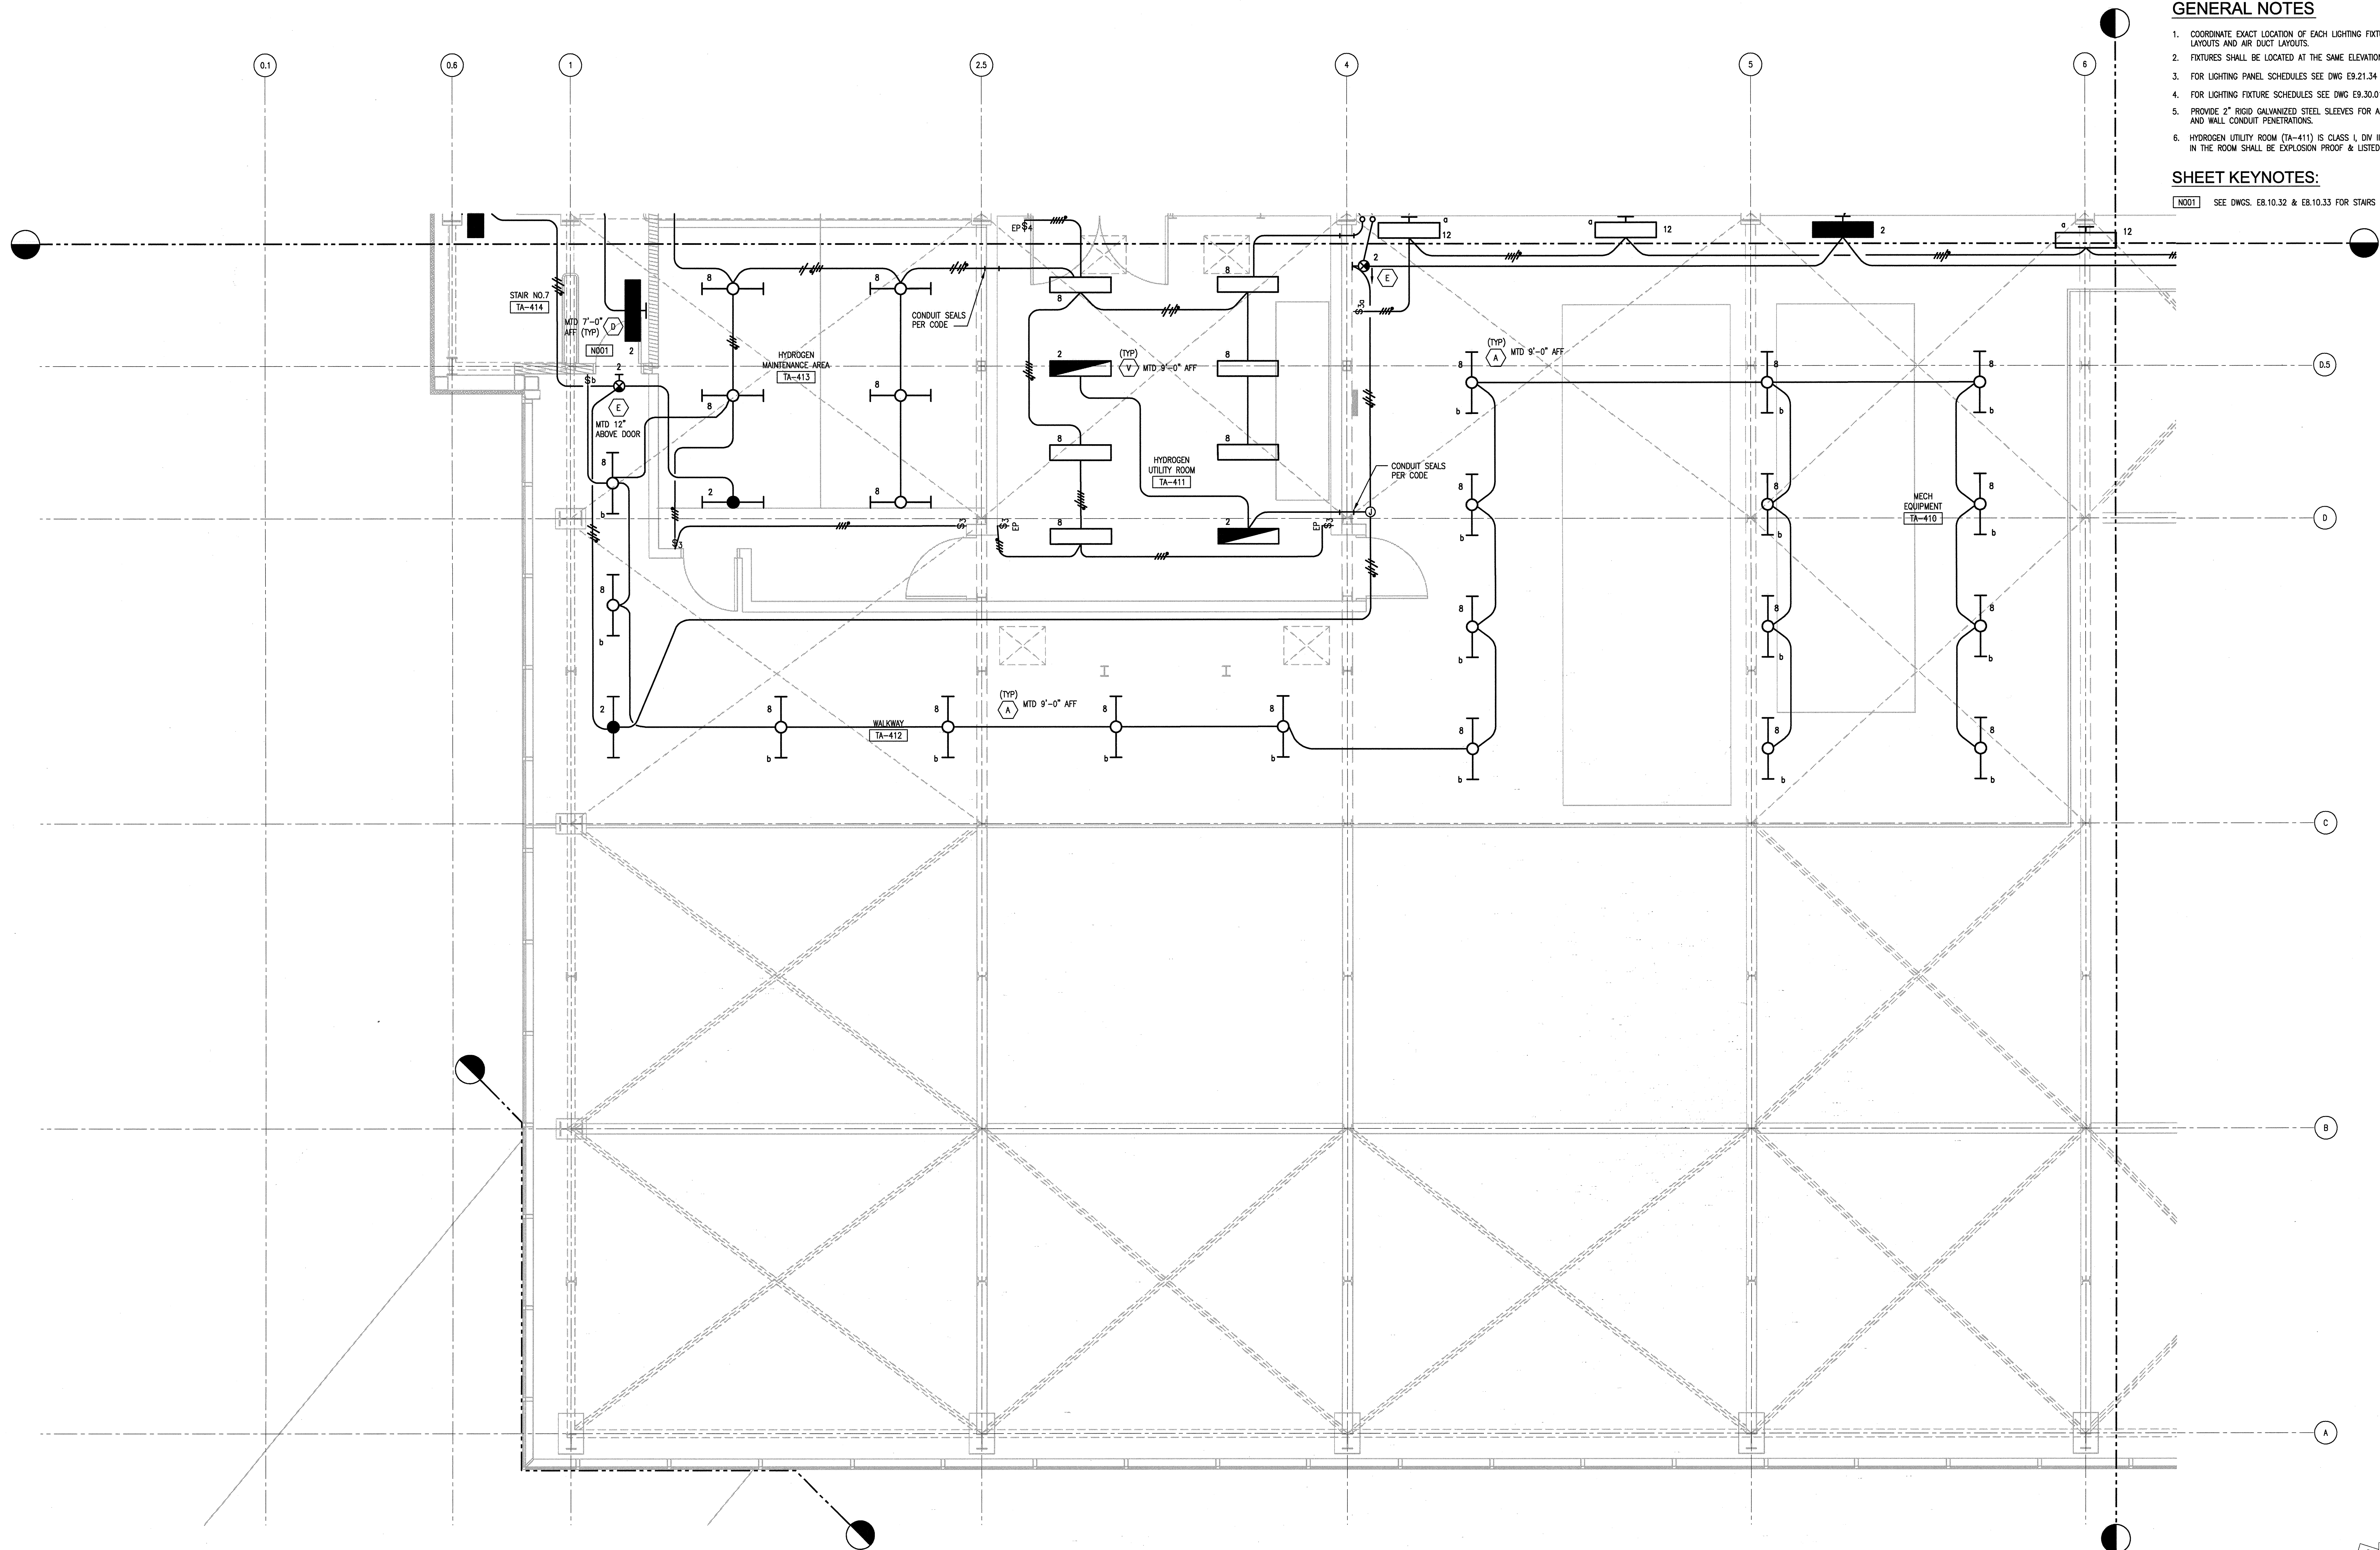

108030700-E8E-8700-A200

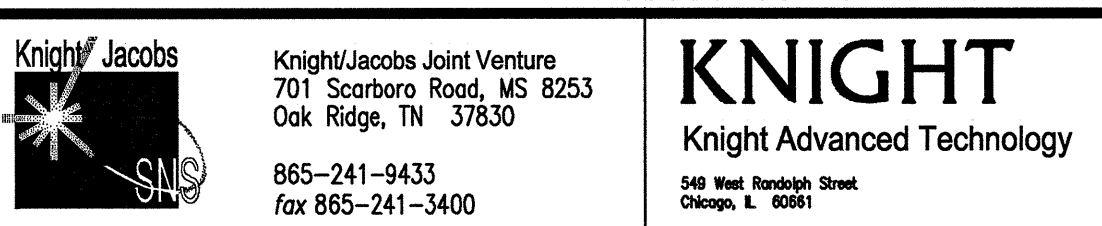

UT-BATTELLE, LLC, • Oak Ridge, Tennessee

PROJECT NAME:

SPALLATION NEUTRON SOURCE

TARGET BUILDING
ELECTRICAL LIGHTING PLAN
LEVEL 4, SECTOR 12

1	48	49	50	PLANT	BLDG	FL	SH.	OF	TYPE	CLASS
3	E	X	X	8	8700		1	1	P	U
S1		S2		53	WBS	E3.04.43				REV
NC		NA			1837					0

NO REPRESENTATION OR WARRANTY, EXPRESSED OR IMPLIED, IS MADE AS TO THE
 ACCURACY, COMPLETENESS OR USEFULNESS OF THE INFORMATION OR STATEMENTS CONTAINED
 IN THESE DRAWINGS, OR THAT THE USE OR DISCLOSURE OF ANY INFORMATION, APPARATUS,
 METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS MAY NOT INFRINGE PRIVATE RIGHTS
 OF OTHERS. NO LIABILITY IS ASSIGNED WITH RESPECT TO THE USE OF, OR FOR DAMAGES
 RESULTING FROM THE USE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS
 DISCLOSED IN THESE DRAWINGS. DRAWINGS MADE AVAILABLE FOR INFORMATION TO BIDDERS
 ARE NOT TO BE USED FOR OTHER PURPOSES AND ARE TO BE RETURNED UPON REQUEST
 OF THE FORWARDING CONTRACTOR.

SECTION AND DETAIL KEY

NUMBER OF SECTION OR DETAIL

THIS DOCUMENT IS CONTROLLED BY

CHANGE CONTROL SYSTEM 3

DRAWING ON WHICH SECTION OR DETAIL IS SHOWN OR TAKEN

ENGINEERING PROCEDURE SWS-ENG-

[illegible][illegible]

RS	RA	REICH	
		1	